

R448 AUTOMATIC VOLTAGE REGULATOR (AVR)

SPECIFICATION, INSTALLATION AND ADJUSTMENTS

SPECIFICATIONS

Normal AVR supply power: 2 auxiliary windings (X1, X2, and Z, Z2)

Shunt supply: 150V~50/60Hz

Rated overload current: 10A, 10s.

Electronic built-in (overload, short circuit, and loss of sensing) protection: If excitation current raises over 10Amps for more than 10 seconds, excitation current will drop automatically to about 1A.

To reset AVR protection, generator must be stopped (or by cutting supply voltage to the AVR).

Protection of power inputs by fuses F1

Voltage sensing: 5VA insulated transformer with input

Voltage tap at:

Terminals 0~110V=95 to 140V

Terminals 0~220V=170 to 260V

Terminals 0~380V=340 to 520V

Output Voltage adjustment by using pot P2

Other sensing voltages by using an adapting other transformers.

Current sensing (parallel operation) CT 2.5 VA class 1 secondary current xxx/1 (optional).

Adjustment of quadrature droop with pot P1.

Under speed (U/F) and LAM protection: for knee frequency adjustable use P4.

Excitation over current adjustment use P5: 4.5 to 10A

For 50/60 Hz (U/F) selection use jumper ST3

Load acceptance module

LAM is suppressed by cutting wire marked ST5

LAM (Load Acceptance Module) function.

When applying a step load to the generator, the rotational speed (frequency) of the genset drops. If the speed is below the preset frequency, the "LAM" circuits drop the voltage about 15% and this way reducing the effective step to about 25%, as long as the speed has not recovered to normal values.

The "LAM" is used either to reduce the speed drop of the engine, during the step load, or to increase the applicable step load for the same speed variation (turbo charged engines) so the engine can recover normal speed quickly.

To prevent voltage oscillations, the frequency threshold must be adjusted about 2 Hz below the lowest frequency in normal operation

Optional items for use with the AVR

CT for parallel operation with other generators

Remote voltage adjusting potentiometer 470 ohm. 3W (*) giving an adjustment range of +/-5% (centering of the range by using internal P2 potentiometer). Remove wire ST4 to connect external potentiometer.

Three phase sensing available by using additional module Model R 730:200 to 500V. Cut ST1 to connect this module.

Generator output voltage is adjusted by using the voltage adjustment potentiometer on the AVR

Power factor regulator (2nd function) and voltage equalization before paralleling with the mains (3rd function)

CT xxx/1 A. 5VA CL1

Module R 724: 2 functions.

Module R 725 A: 3 functions.

EMI suppression

(*)Note: For a wider voltage adjustment range and 1 k ohm/3W pot may be used.

The R 730 module is not compatible with paralleling.

Special applications

Field de-energizing

Cutting excitation current is accomplished by switching off the supply power to AVR (1 lead on each auxiliary winding)

Contacts capacity: 10A. 250V AC

This is the same connection used to reset internal protection of AVR.

Static test AVR

* Testing the A. V. R. by using a static test does not necessarily mean it can operate properly.

* But inversely, if the A. V. R. does not test properly during static tests, it is obviously defective Setup the test (see drawing).

Supply voltage must be 100 to 140V and the light bulb must be rated for 220V use you can also use 2 x 110V bulbs in series.

Total lamp load must not exceed 100 Watt

1) - Adjust AVR voltage by moving screw P2 to maximum CCW position

2) - Apply power to the AVR the lamp should flash momentarily and turn off.

3) - Slowly rotate the AVR voltage screw clockwise:

The bulb will slowly light up and reach full brilliance before P2 is moved completely clockwise, at the regulating point a small movement back and forth with P2 will turn the bulb on and off. If the lamp remains constantly on/off the AVR is defective.

Repeat the test supplying AVR power through terminals X1, X2, and then test again by supplying power through terminals Z1, Z2.

Static test LAM

(under-speed protection)

Voltage adjustment Pot P2 should be set in its normal position just when the lamp just begins to glow. Turn P4 slowly CCW the brightness should decrease suddenly the voltage at AVR's output terminals E+, E- must fall about 15%. Then resetting P4 to initial position: the lamp should glow normally as before.

Adjustment procedure

- a) Initial setting of potentiometers
 - P2 VOLTAGE:lowest fully CCW.
 - P3 STABILITY:middle position.
 - P1 QUADRATURE VOLTAGE DROP:fully CCW
 - P5 EXCITATION CURRENT LIMIT:to be adjusted only if necessary maximum fully CW.
 - Remote voltage trimmer Rhe -470 OHM (jumper ST4 removed):middle position.
- b) Connect one analog (needle type) voltmeter cal.50V D.C.across E+,E-terminals and another (300V-500V or 1000V) A.C.across the alternator output terminals.
- c) Make sure that the 50/60 Hz link is correctly connected
- d) (P2) potentiometer must be set maximum anti-clockwise
- e) (P4) (V/Hz) must be set maximum clockwise
- f) (P3) (Stability) has to be adjusted maximum clockwise -1/3.
- g) Start and adjust the engine speed corresponding to 48Hz for 50 Hz (nominal) or 58 for 60Hz.
- h) Adjust output voltage with (P2) to the required value
 - rated voltage UN if generator operates alone (for example 400V)
 - or UN+2 to 4% for parallel operation with CT (i.e. 410V-see below)
- If voltage is unstable, adjust (P3) (try in both directions), noting voltage across E+, E- (approx. 1CV dc) The fastest recovery time may be achieved when (P3) is set close to the limit of instability. If there is no stable position try adjustment again after having cut or reconnecting link ST2 (normal /fast).
- i) Turn (P4) anticlockwise until the voltage drops about 15%.
- j) Modify engine speed around 48 or 58 Hz in order to check the LAM voltage drop (~15%).
- k) Readjust speed of genset to its normal no-load level

ADJUSTMENTS IN PARALLEL OPERATION

Note: Preliminary to any adjustment on the AVR, make sure that engine speeds are similar.

- l) Presetting for parallel operation (with CT connected to terminals S1, S2 of terminal strip J2)
 - Potentiometer P1 (Voltage droop) in middle position.
- Switch on the rated load (P.F.0.8 inductive).The output voltage should drop 2% to 3%.If voltage rises,reverse the 2 leads from the CT.
- m) No load voltages must be identical on all gensets working together and in parallel.
 - Synchronize and parallel the gensets together.
 - By adjusting engine speed, reduce power exchange, to 0 KW
 - By adjusting voltage pot (P2 or Rhe) on one of the machines try to cancel (or minimize) circulating currents.
 - Do not change voltage adjustments.
- n) Switch on the load (adjustments cannot be made if there is no reactive load).

- By adjusting speed, balance the KW (proportionally to the rated powers of each genset).
- By adjusting voltage droop with pot. P1,balance the output currents.

Adjustment of maximum excitation current (Excitation ceiling)

- Static adjustment of excitation current limitation, potentiometer P5 (factory adjustment: 10A, fuse caliber: 10A-10seconds).

The factory adjustment corresponds to the excitation current for a sustained 3 phase short circuit, of about 3 times the rated current, unless otherwise specified(*) It is possible to reduce the maximum excitation level by a static method which is safer for the alternators and the network.

Disconnect the supply leads (X1 X2, Z1, Z2) and sensing leads (0-110-220-380) on the AVR. Connect the supply as shown (X1, X2 0,110V). Connect an ammeter (10A , dc) in series with the exciter field. Turn P5 fully CCW.Switch on the supply. If there is no output current from AVR,turn P2 (voltage) clockwise until ammeter indicates a stabilized current.

Switch the supply off, then on again, Turn P5 clockwise until the required current is obtained in the exciter field, (limit to 10A)



Checking internal protection:

Switch off (B): the excitation current must rise to the pre-set high level, and remain at this level for a period of more than 10 seconds, then fall to less than 1A.


To reset, switch off the supply by opening switch (A).

Note: After having adjusted the excitation current limitation.

(*): In many countries short-circuit current equal to 3 times IN is obligatory in order to allow selective tripping of circuit breakers.

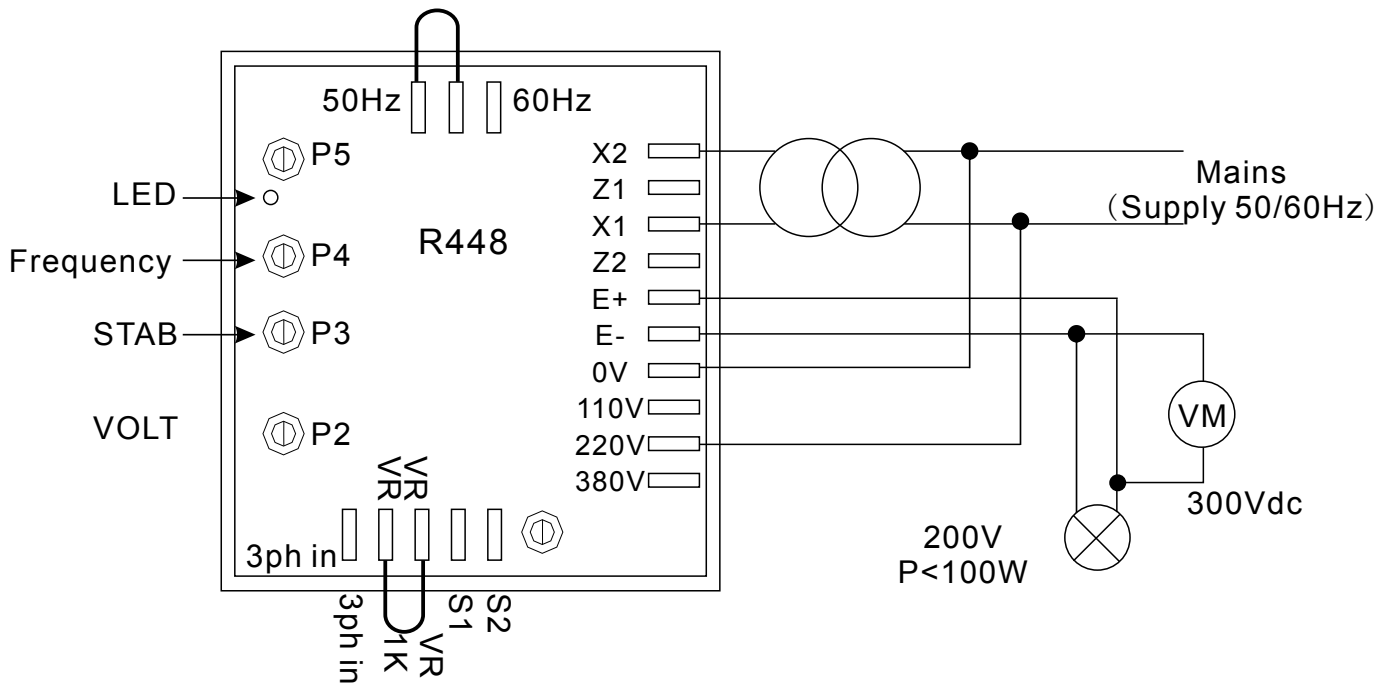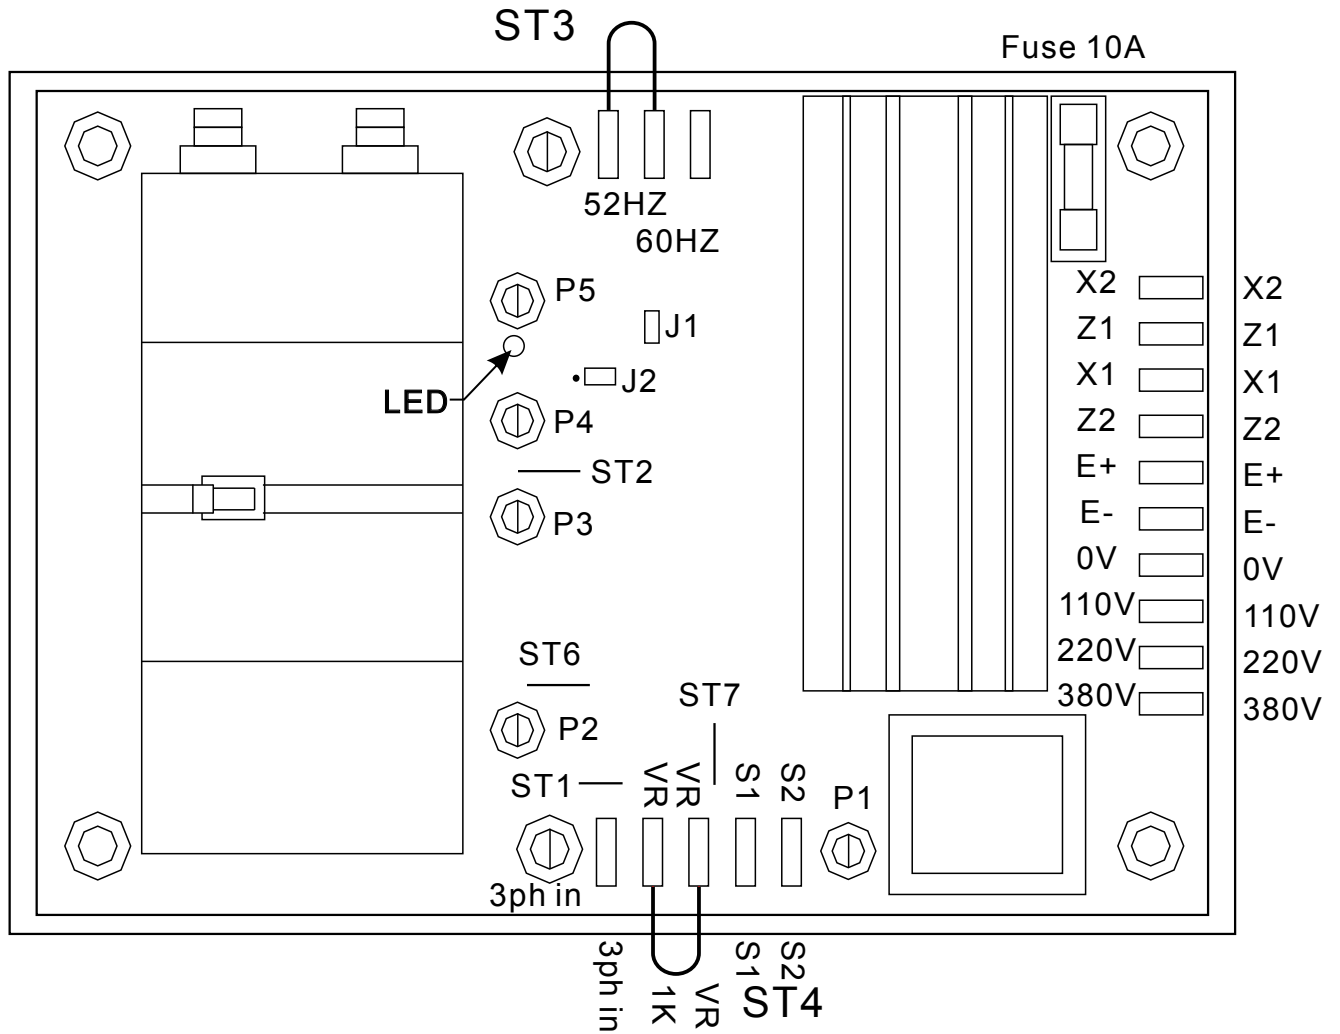

Static test AVR

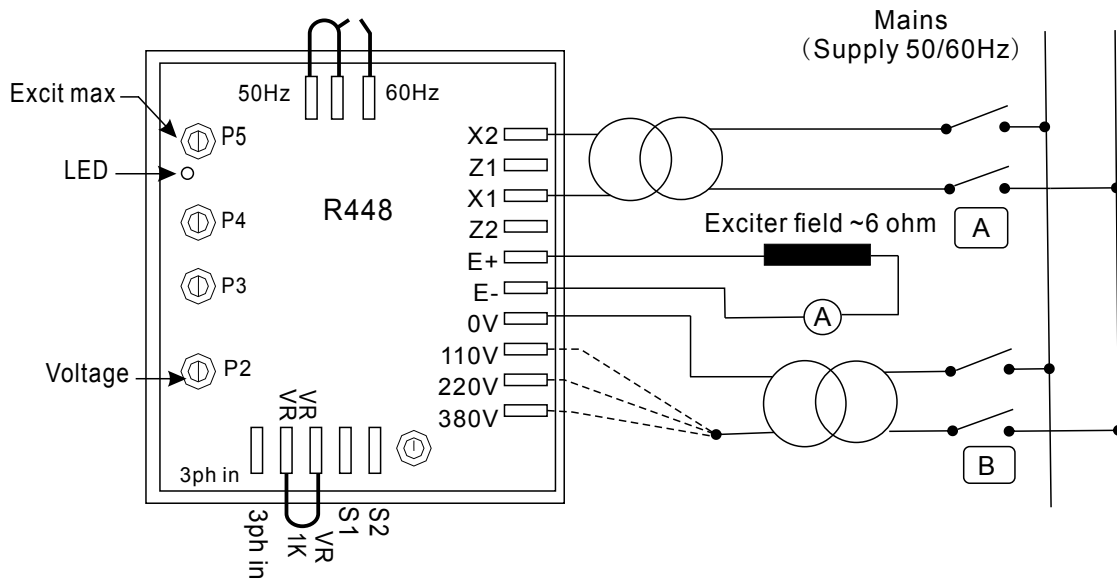

Adjustment of maximus excitation current

